

*Recommended*  
**Selection and Usage Guide**  
*for*  
**Standard Steel Doors**



Standards As Tough As Steel.™  
© 2018 Steel Door Institute

**STEEL DOOR INSTITUTE**  
30200 DETROIT ROAD • CLEVELAND, OHIO 44145

## Recommended Selection and Usage Guide for Standard Steel Doors

### Purpose

To establish guide criteria for the selection and usage of 1-3/4" and 1-3/8" standard steel doors.

### Selection

Standard steel doors are classified in four levels: Level 1 – 1-3/4" and 1-3/8" standard duty, Level 2 – 1-3/4" heavy duty, Level 3 – 1-3/4" extra heavy duty and Level 4 – 1-3/4" maximum duty.

Each of the four levels noted above offer a range of construction models and designs to meet architectural requirements for preference and appearance. The standard steel door construction models are full flush, seamless and, stile and rail.

Recommended minimum gauge requirements for the various levels and models of standard steel doors are indicated in table 1.

### Usage

Selection of standard steel doors for general usage is made by analyzing criteria such as frequency of use, including subjection to and degree of possible abuse. Other criteria to be considered in door selection are: conformance to local building codes and fire code regulations; sound attenuation and/or insulation requirements; and architectural design and appearance.

Table 2 is a reference aid matching standard duty, heavy duty, extra heavy duty and maximum duty doors with general usage requirements within the classification of buildings. Where optional door levels and models are indicated, further analysis on an individual job basis is recommended.

When unusual or special door usage conditions are encountered, contact a representative member of the Steel Door Institute for consultation and guidance.

### Notes

**Tolerances** – All values which do not carry specific tolerances or are not marked maximum or minimum shall have the following tolerances: Linear dimensions shall be  $\pm 1/16$  in. (1.6 mm). Weight or force shall be  $\pm 2\%$ . Angles shall be  $\pm 2$  degrees. Where only minus tolerances are given, the dimensions are permitted to be exceeded at the option of the manufacturers.

**Gauge vs. Thickness** – While the term 'gauge' is no longer common for defining material thickness it is still used to specify doors and frames for ordering purposes. The term 'thickness' is used when defining the actual dimension of an item, and the term 'gauge' is used in the context of specifying a particular door or frame.







**Table 1 – Standard steel door grades and models**

Level		Model	Full Flush or Seamless			Construction
			MSG No.	IP in	SI mm	
1	Standard Duty	1	20	0.032	0.8	Full Flush
		2				Seamless
2	Heavy Duty	1	18	0.042	1	Full Flush
		2				Seamless
3	Extra Heavy Duty	1	16	0.053	1.3	Full Flush
		2				Seamless
		3				*Stile & Rail
4	Maximum Duty	1	14	0.067	1.6	Full Flush
		2				Seamless

\*Stiles and rails are 16 gauge; flush panels, when specified, are 18 gauge.


For complete standard steel door construction specifications and available sizes, refer to ANSI/SDI A250.8-2017, *Specifications for Standard Steel Doors and Frames (SDI-100)* and ANSI/SDI A250.4-2018 *Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors, Frames and Frame Anchors*.

Table 2 – Suggested door levels and applications

Building Types	Standard Steel Door Levels				Door Design Nomenclature					
	Level 1 Standard Duty 1-3/8" 1-3/4"	Level 2 Heavy Duty 1-3/4" only	Level 3 Extra Heavy Duty 1-3/4" only	Level 4 Maximum Duty 1-3/4" only	 F	 G	 V	 FG	 N	 L
<b>Apartment</b>										
Main Entrance		•	•		•	•		•	•	
Unit Entrance	•	•	•		•					
Bedroom	•				•					
Bathroom	•				•					•
Closet	•				•					•
Stairwell		•	•				•		•	
Mechanical		•	•		•					•
<b>Dormitory</b>										
Main Entrance		•	•	•		•		•	•	
Unit Entrance	•	•			•					
Bedroom	•	•			•					
Bathroom	•	•			•					•
Closet	•	•			•					•
Stairwell		•	•				•		•	
<b>Hotel – Motel</b>										
Unit Entrance	•	•			•					
Bathroom	•				•					
Closet	•				•					•
Stairwell		•	•				•		•	
Storage & Utility		•	•		•					•
<b>Medical</b>										
Main Entrance			•			•		•	•	
Patient Room		•			•					
Stairwell		•	•				•		•	
Operating & Exam.		•	•		•		•		•	
Bathroom		•	•		•					•
Closet	•	•			•					•
Recreation		•			•		•			
Kitchen		•	•				•			
Mechanical/Storage/ Utility		•	•		•					•
<b>Industrial</b>										
Entrance & Exit			•	•		•		•	•	
Office	•	•			•	•				
Production			•			•			•	•
Toilet		•	•		•					•
Tool			•	•	•					
Trucking			•	•		•				
Monorail			•	•	•					
<b>Office</b>										
Entrance			•			•		•	•	
Individual Office	•				•	•				
Closet	•				•					•
Toilet		•	•		•					
Stairwell		•	•				•		•	
Equipment		•	•		•					
Boiler		•	•		•					•
<b>School</b>										
Entrance & Exit			•	•		•		•	•	
Classroom		•				•			•	
Toilet		•	•		•					•
Gymnasium			•	•	•	•	•		•	
Cafeteria		•	•			•				
Stairwell		•	•				•		•	
Closet	•	•	•	•	•					•

Note: Table 2 is only a guide. Please consult ANSI/SDI A250.8 and applicable building codes for additional requirements. For additional designs refer to SDI-134, *Nomenclature for Standard Steel Doors and Steel Frames*.

**Steel Door Institute Standard Steel Door Design Nomenclature**

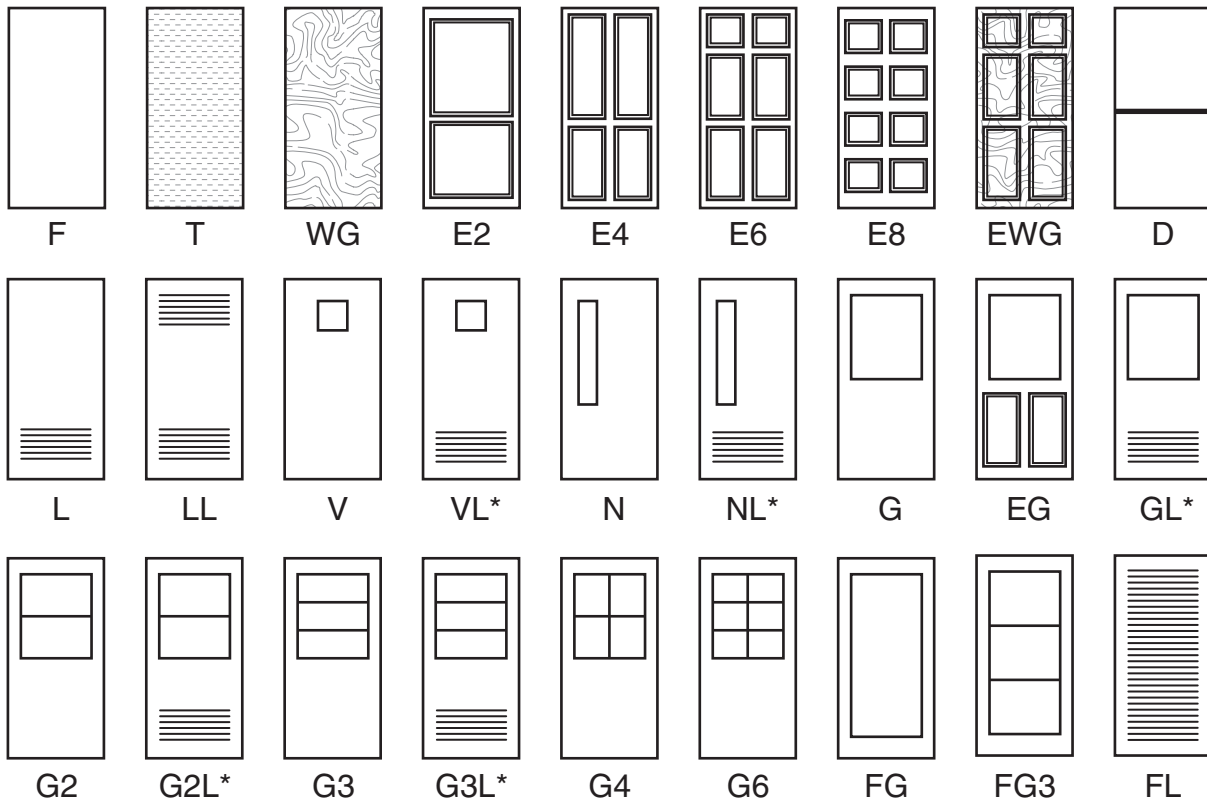

\* Note: Design combination is indicated by light followed by louver.

Consult SDI-134 for further information on standard design nomenclature for Standard Steel Doors.

**Nomenclature Letter Symbols**

- |                       |                                       |  |
|-----------------------|---------------------------------------|--|
| F – Flush             | EWG – 6 Panel Embossed and Wood Grain | NL – Narrow Light and Louvered             |
| T – Textured          | D – Dutch Door                        | G – Half Glass (options G2, G3, G4 and G6) |
| WG – Wood Grain       | L – Louvered (top or bottom)          | EG – Embossed and Half Glass               |
| E2 – 2 Panel Embossed | LL – Louvered (top and bottom)        | GL – Half Glass and Louvered               |
| E4 – 4 Panel Embossed | V – Vision Light                      | FG – Full Glass (option FG3)               |
| E6 – 6 Panel Embossed | VL – Vision Light and Louvered        | FL – Full Louver                           |
| E8 – 8 Panel Embossed | N – Narrow Light                      |  |

Louvered door designs are further specified as inserted louver (I), pierced (P), or air condition grille (A).  
When ordering, specify design, louver size and/or free area requirements.



Standards As Tough As Steel.™

**STEEL DOOR INSTITUTE**

30200 DETROIT ROAD • CLEVELAND, OHIO 44145

440/899-0010 • FAX 440/892-1404

www.steeldoor.org