

Manufacturing Tolerances *for* **Standard Steel Doors** **and Frames**



Standards As Tough As Steel.™

© 2023 Steel Door Institute

STEEL DOOR INSTITUTE

30200 DETROIT ROAD • CLEVELAND, OHIO 44145

This page left intentionally blank.

Manufacturing Tolerances for Standard Steel Doors and Frames

1 Introduction

It is the intent of this publication to provide users with definitive information regarding manufacturing tolerances of standard steel doors and frames. This document is not to be referenced for manufacturing tolerances of specialty products, i.e., bullet, acoustical, windstorm. This document is intended for in-plant inspections. It may be used as a reference document for on-site inspections where there is no evidence of damage to material or improper installation.

The information contained herein pertains to doors and frames manufactured in accordance with ANSI/SDI A250.8, *Specifications for Standard Steel Doors and Frames*. It is not intended to be a reference for specialty doors or unusual door and frame conditions.

2 Reference Documents:

ANSI/SDI A250.8-2017 *SDI 100 Specifications for Standard Steel Doors & Frames*

ANSI/SDI A250.6-2020 *Recommended Practice for Hardware Reinforcings on Standard Steel Doors and Frames*

ANSI/SDI A250.3-2019 *Test Procedure & Acceptance Criteria for Factory Applied Finish Coatings for Steel Doors & Frames*

ANSI/SDI A250.10-2020 *Test Procedure & Acceptance Criteria for Prime Painted Steel Surfaces for Steel Doors & Frames*

ANSI/SDI A250.11-2022 *Recommended Erection Instructions for Steel Frames*

ANSI/BHMA A115 *Specifications for Steel Door and Frame Preparation for Hardware* (A115.1 – A115.18)

ASTM A568-2019 *Standard Specification for Steel, Sheet, Carbon, Structural, and High-Strength, Low-Alloy, Hot-Rolled and Cold-Rolled, General Requirements for*

ASTM A653-2018 *Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process*

ASTM A924-2022 *Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process*

NFPA 80, *Standard for Fire Doors and Other Opening Protectives*, 2022 Edition.

SDI 122-2021, *Installation and Troubleshooting Guide for Standard Steel Doors and Frames*

SDI 134-2020 *Glossary of Terms for Hollow Metal Doors and Frames*

3 Notes

3.1 Tolerances

All values which do not carry specific tolerances or are not marked maximum or minimum shall have the following tolerances: Linear dimensions shall be $\pm 1/16$ in. (1.6 mm). Weight or force shall be $\pm 2\%$. Angles shall be ± 2 degrees. Where only minus tolerances are given, the dimensions are permitted to be exceeded at the option of the manufacturers.

3.2 Gauge vs. Thickness

While the term 'gauge' is no longer common for defining material thickness it is still used to specify doors and frames for ordering purposes. The term 'thickness' is used when defining the actual dimension of an item, and the term 'gauge' is used in the context of specifying a particular door or frame.

3.3 Metric

Values stated without parenthesis are the requirement. Values in the parenthesis are explanatory or approximate information.

4 Materials and Finishes

4.1 Steel Thickness

Manufacturers no longer order sheet and coil to a specific gauge, but rather to a minimum decimal thickness. This thickness is the lowest of the range for a specific gauge. The steel supplier is therefore permitted to exceed, but not be less than the specified decimal thickness. These minimum values meet the stringent requirements of test facilities and labeling agencies such as UL Solutions, and ITS/Intertek Testing/War-nock Hersey. Examples of minimum allowable steel thickness:

Gauge (MSG)	Minimum
20	0.032"
18	0.042"
16	0.053"
14	0.067"
12	0.093"
10	0.123"
7	0.167"

Gauge (MSG) are for reference purposes only.

4.2 Steel Coatings

Thickness of metallic coatings (generally zinc) are defined by ASTM A924, *Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process* and A653, *Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process*. The two most commonly used designations are A40 and A60. Minimum requirements for these designations are:

A40 = 0.40 oz/ft² total both sides.

A60 = 0.60 oz/ft² total both sides.

For reference, 1 oz/ft² = 1.7 mils thickness.

4.3 Factory Applied Coatings

Factory applied coatings (primer, finish paint, etc.) are subject to performance standards rather than thickness, the dry film thickness is irrelevant. Such coatings must comply with performance criteria of:

ANSI/SDI A250.3 – *Test Procedure and Acceptance Criteria for Factory Applied Finished Coatings for Steel Doors and Frames*

OR

ANSI/SDI A250.10 – *Test Procedure and Acceptance Criteria for Prime Painted Steel Surfaces for Steel Doors and Frames*.

5 Frame Tolerances

5.1 Frame Cross Section Profile

Permissible tolerances in frame profile surfaces are as shown in Figure A:

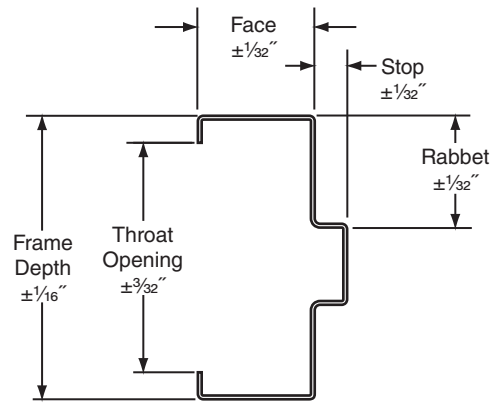


Figure A – Profile Tolerances

5.2 Frame Opening & Vertical Locations

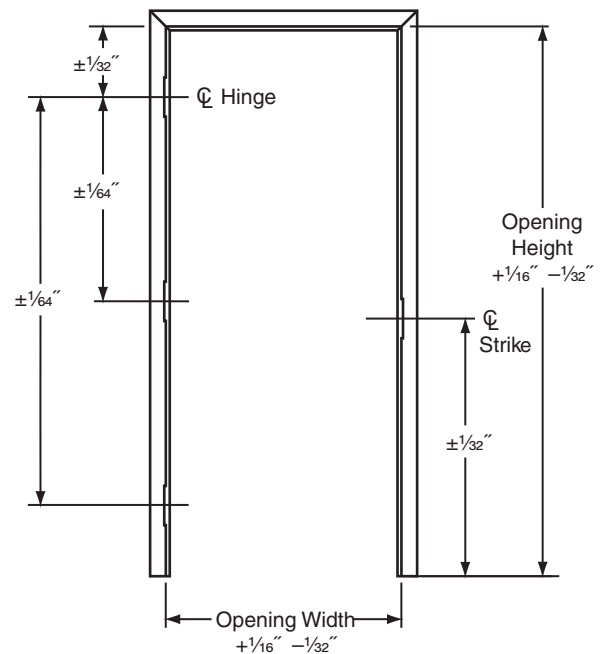


Figure B – Opening Tolerances

5.3 Bow or Twist of Jambs or Header

Realizing that frames are somewhat “pliable,” and require bracing and alignment during installation, allowable deformation (bow, twist, etc.) of jambs or header of frame **prior to installation** shall not result in a reduction of opening sizes more than 1/16" beyond those shown in Figure “B” when measured at any point.

5.4 Horizontal Alignment of Door Within Rabbet

Hinge and strike backsets shall allow the horizontal centerline of the door to be in line with the horizontal centerline of the frame rabbet $\pm \frac{1}{32}$ " **prior to installation**. Figure "C" is an example based on a $1 \frac{3}{4}$ " door in a $1 \frac{5}{16}$ " rabbet.

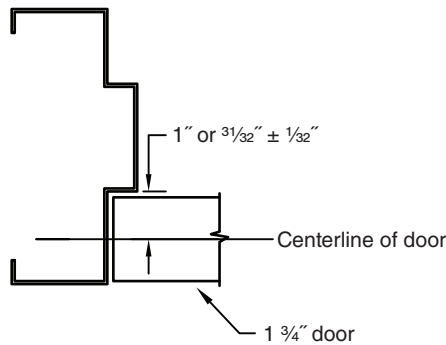


Figure C – Horizontal Alignment

5.5 Frames with Lights or Panels

Opening sizes (width or height) for side lights or transom lights or panels and for borrowed light frames shall be subject to a tolerance of $\pm \frac{1}{16}$ " for each individual light or panel. These tolerances shall be non-accumulative so that the overall frame opening sizes are not increased by more than $\frac{1}{8}$ ". (Reference Figure D.)

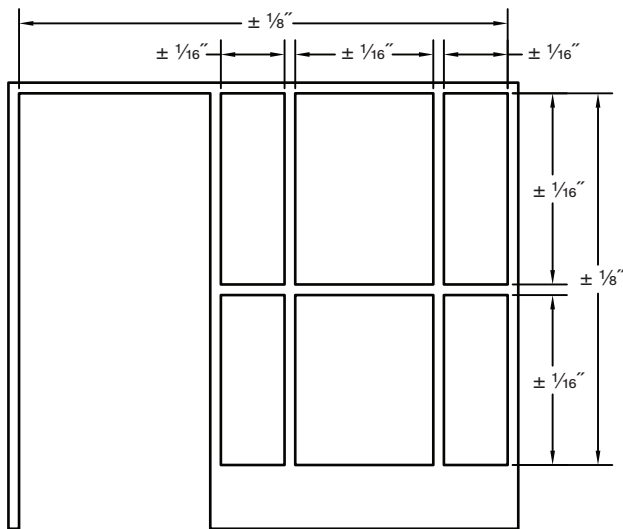


Figure D – Frames with Lights or Panels

6 Door Tolerances

6.1 Door Size, Thickness, and Vertical Locations

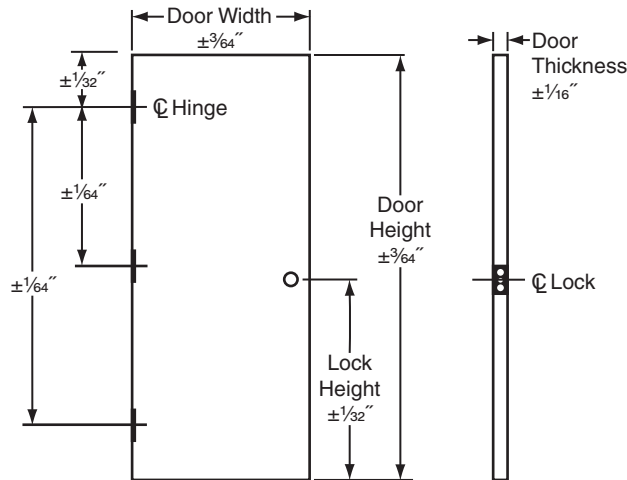


Figure E – Doors

6.2 Door Squareness

When measured diagonally from corner to corner along the same face, the measurements shall be within $\frac{1}{16}$ " of each other. (Reference Figure F.)

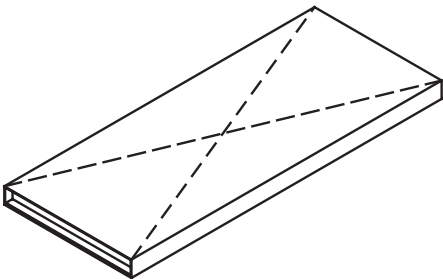


Figure F – Squareness

6.3 Door Perimeter Flatness

Using a straightedge suitable for the size of the door, the straightedge is laid against the door face at or within $\frac{1}{4}$ " of the top, bottom, hinge edge, and lock edge on both faces any deviation between the face and the straightedge shall not allow a 0.0625" rod or block to pass. (Reference Figure G.)

Note: The straightedge shall be allowed to "rest" naturally on the door surface, not pulled down at one end to meet the door.

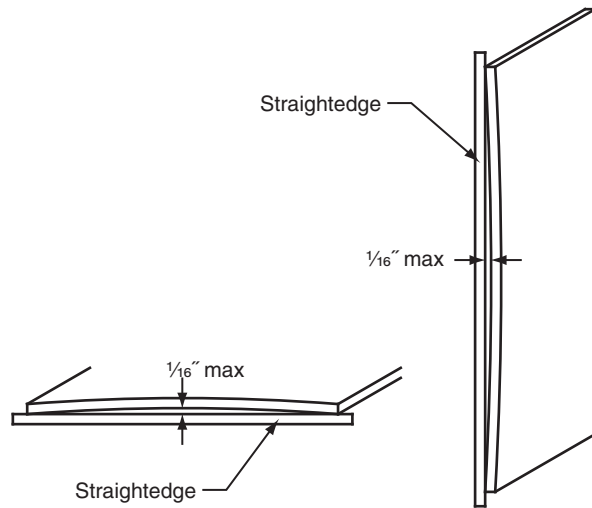


Figure G – Flatness

6.4 Door Face Bow or Crown (Flatness)

When a straightedge suitable for door size is laid diagonally against the door face at least $\frac{1}{2}$ " from corners any deviation between the face and the straightedge shall not allow a 0.125" rod or block to pass.

Note: The straightedge shall be allowed to "rest" naturally on the door surface, not pulled down at one end to meet the door. (Reference Figure H.)

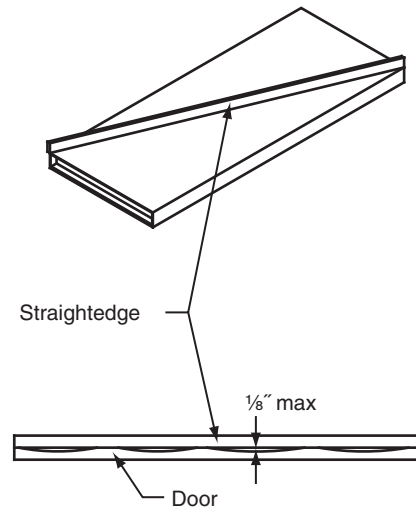


Figure H – Flatness

6.5 Door Twist

The door is laid on a suitable, flat fixture or surface that is free of any warp, bow, or twist. Support blocks of identical heights shall be inserted between the fixture or surface and the door face at all four corners of the door. Any deviation space between the face and the support blocks shall not allow a 0.0625" rod or block to pass. An additional two blocks shall be inserted between fixture or surface and the door face at or near mid points of door height.

Note: The door shall be allowed to "rest" naturally on the support blocks, not pulled down at any corner to meet the blocks. (Reference Figure I.)

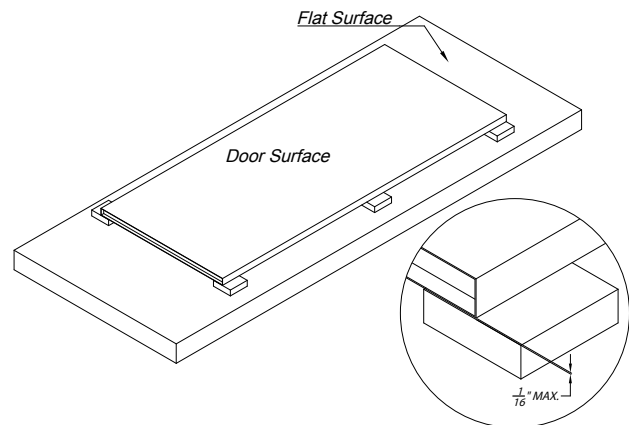


Figure I – Door Twist

6.6 Doors with Lights or Panels

Opening sizes (width or height) for lights or panels cut into doors shall be subject to a tolerance of $\pm 1/16"$ for each individual light or panel.

7 Hardware Preparations

7.1 Vertical Locations

Tolerances for vertical locations are as noted in Paragraphs 5.2 and 6.1.

7.2 Horizontal Alignment

Tolerances for horizontal alignment of door and rabbet are as noted in Paragraph 5.4.

7.3 Mortise Depth

The depth of hardware items mortised into edges of doors (such as hinges, strikes, lock fronts, flushbolts) shall be as defined on manufacturer's templates and/or ANSI A156.115 documents subject to an additional tolerance of $\pm 1/64"$.

7.3.1 Cutout Depth at Frame or Door Faces

To allow for field adjustments, typically accomplished by shimming, hardware cutouts (such as hinges) that extend from door edges around to faces or from frame rabbet around to faces are allowed to exceed mortise depth by $1/16"$.

7.3.2 Depth for Recessed or Concealed Hardware


The depth for hardware items recessed into top or bottom of doors or edges of doors (such as pocket pivots, floor closers, top pivots, concealed closers or holders, etc) shall be as defined on manufacturer's templates subject to an additional tolerance of $+1/16" - 0"$. Notches in door faces shall have similar tolerances.

8 Frame Installation

8.1 Frame Installation Tolerances

While this document is mainly concerned with tolerances relating to the manufacturing process, openings will not function properly if the frame is not installed within recognized tolerances.

Figures "J-K-L-M" show examples of the accuracy to be maintained while setting and installing frames. Instructions for installation may be found in ANSI/SDI A250.11.

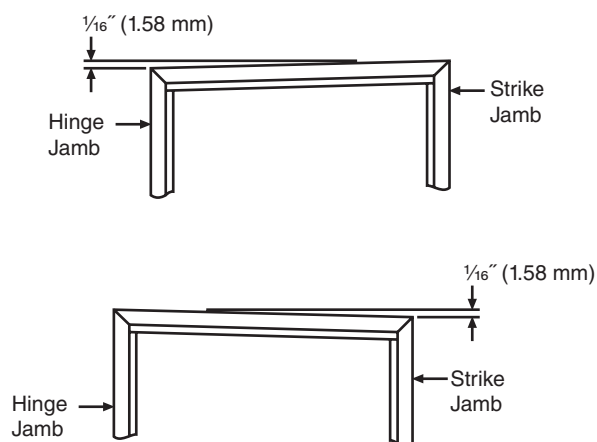

Maximum 1/16" allowable tolerance on total opening.

Figure J – Squareness

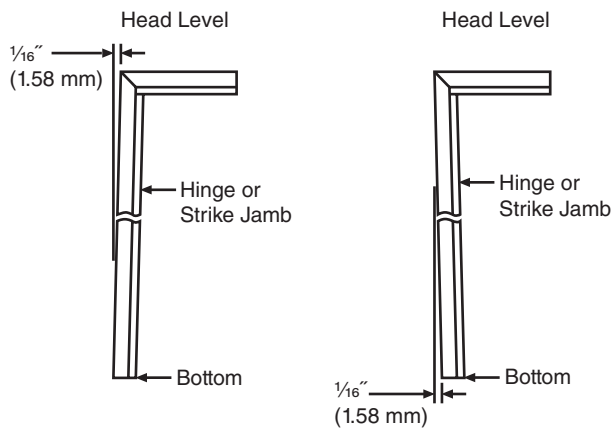


Figure K – Plumbness

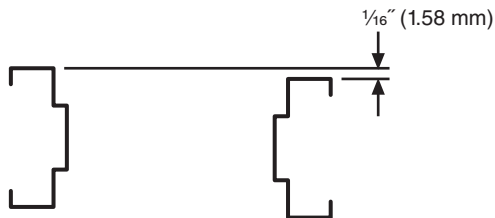


Figure L – Alignment

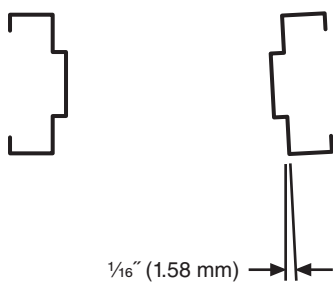


Figure M – Twist

8.2 Troubleshooting

Further information regarding corrective actions for door & frame openings may be found in SDI-122.

This page left intentionally blank.

This page left intentionally blank.

This page left intentionally blank.

AVAILABLE PUBLICATIONS

Specifications

- ANSI/SDI A250.6** Recommended Practice for Hardware Reinforcing on Standard Steel Doors and Frames
- ANSI/SDI A250.8** Specifications for Standard Steel Doors and Frames (SDI-100)
- ANSI/SDI A250.14** Hardware Preparation in Steel Doors and Steel Frames
- SDI-108** Recommended Selection & Usage Guide for Standard Steel Doors
- SDI-118** Basic Fire Door, Fire Door Frame, Transom/Sidelight Frame, and Window Frame Requirements
- SDI-128** Guidelines for Acoustical Performance of Standard Steel Doors and Frames
- SDI-129** Hinge and Strike Spacing
- SDI-133** Guideline for Specifying Steel Doors & Frames for Blast Resistance
- SDI-136** Guideline for Specifying Windstorm Products

Test Procedures

- ANSI/SDI A250.3** Test Procedure & Acceptance Criteria for Factory Applied Finish Coatings for Steel Doors and Frames
- ANSI/SDI A250.4** Test Procedure & Acceptance Criteria for Physical Endurance for Steel Doors, Frames and Frame Anchors
- ANSI/SDI A250.10** Test Procedure & Acceptance Criteria for Prime Painted Steel Surfaces for Steel Doors and Frames
- ANSI/SDI A250.13** Testing and Rating of Severe Windstorm Resistant Components for Swinging Door Assemblies for Protection of Building Envelopes (Not applicable for FEMA 320/361 or ICC-500 Shelters)
- SDI-113** Standard Practice for Determining the Steady-State Thermal Transmittance of Steel Door and Frame Assemblies
- SDI-131** Accelerated Physical Endurance Test Procedure for Steel Doors

Construction Details

- ANSI/SDI A250.11** Recommended Erection Instructions for Steel Frames
- SDI-110** Standard Steel Doors & Frames for Modular Masonry Construction
- SDI-111** Recommended Details for Standard Steel Doors, Frames, Accessories and Related Components
- SDI-122** Installation Troubleshooting Guide for Standard Steel Doors & Frames

Miscellaneous Documents

- SDI-112** Zinc-Coated (Galvanized/Galvannealed) Standard Steel Doors and Frames
- SDI-117** Manufacturing Tolerances for Standard Steel Doors and Frames
- SDI-124** Maintenance of Standard Steel Doors & Frames
- SDI-127** Industry Alert Series (A-L)
- SDI-130** Electronic Hinge Preparations
- SDI-134** Glossary of Terms for Hollow Metal Doors and Frames
- SDI-135** Guidelines to Measure for Replacement Doors in Existing Frame Openings

MEMBERS OF THE STEEL DOOR INSTITUTE

CECO

AN ASSA ABLOY DOOR GROUP COMPANY
9159 Telecom Drive
Milan, TN 38358-3425
(731) 686-8345
www.cecodoor.com

CURRIES

AN ASSA ABLOY DOOR GROUP COMPANY
1502 12th Street, P.O. Box 1648
Mason City, IA 50402-1648
(641) 423-1334
www.curries.com

DEANSTEEL MANUFACTURING CO.

931 S. Flores Street
San Antonio, TX 78204-1406
(210) 226-8271
www.deansteel.com

DE LA FONTAINE INDUSTRIES, INC.

3 Normac Road
Woburn, MA 01801
(781) 932-8663
www.delafontaine.com

DCI

7980 Redwood Avenue
Fontana, CA 92336-1638
(909) 770-5700
www.dcihollowmetal.com

HOLLOW METAL XPRESS (HMX)

3440 Stanwood Boulevard
Huntsville, AL 35811-9021
(256) 851-6670
www.HMXpress.com

MESKER DOOR

3440 Stanwood Boulevard
Huntsville, AL 35811-9021
(256) 851-6670
www.meskerdoor.com

MPI

319 North Hills Road
Corbin, KY 40701
(606) 523-0173
www.metalproductsinc.com

PIONEER INDUSTRIES, INC.

AN ASSA ABLOY DOOR GROUP COMPANY
111 Kero Road
Carlstadt, NJ 07072
(201) 933-1900
www.pioneerindustries.com

PREMIER STEEL DOORS & FRAMES

AN ASSA ABLOY DOOR GROUP COMPANY
2840 Sterlington Road
Monroe, LA 71203
(318) 361-0796
www.trustpremier.com

REPUBLIC DOORS & FRAMES

155 Republic Drive
McKenzie, TN 38201-0580
(731) 352-3383
www.republicdoor.com

STEELCRAFT

9017 Blue Ash Road
Cincinnati, OH 45242
(513) 745-6400
www.steelcraft.com

STILES

AN ASSA ABLOY DOOR GROUP COMPANY
1885 Kinser Road
Ceres, CA 95307
(209) 538-3667
www.stilesdoors.com



Standards As Tough As Steel.™

2/14/2025

STEEL DOOR INSTITUTE

30200 DETROIT ROAD • CLEVELAND, OHIO 44145
440.899.0010 • www.steeldoor.org